

01

NEW

MV 33 KV STANDOFF INSULATOR

مقره اتکایی ۳۳ کیلوولت



JEC **Jebal Electric**
Manufacturing & Commercial co.


WWW.JEC.IR

REFERENCE TABLE

مقره فشار متوسط تابلویی
محصول شرکت جبال الکتریک
سطح ولتاژی ۳۳ کیلو ولت

DIMENSIONS

PRODUCT CODE	IEC TYPE	H(mm)	D(mm)	INSERTS sideA sideB	CREEPAGE DISTANCE (mm)	REFERENCE STANDARD
MV33	JO2-170	300	80	M16 2M06+M12	460	IEC60660 - IEC60273

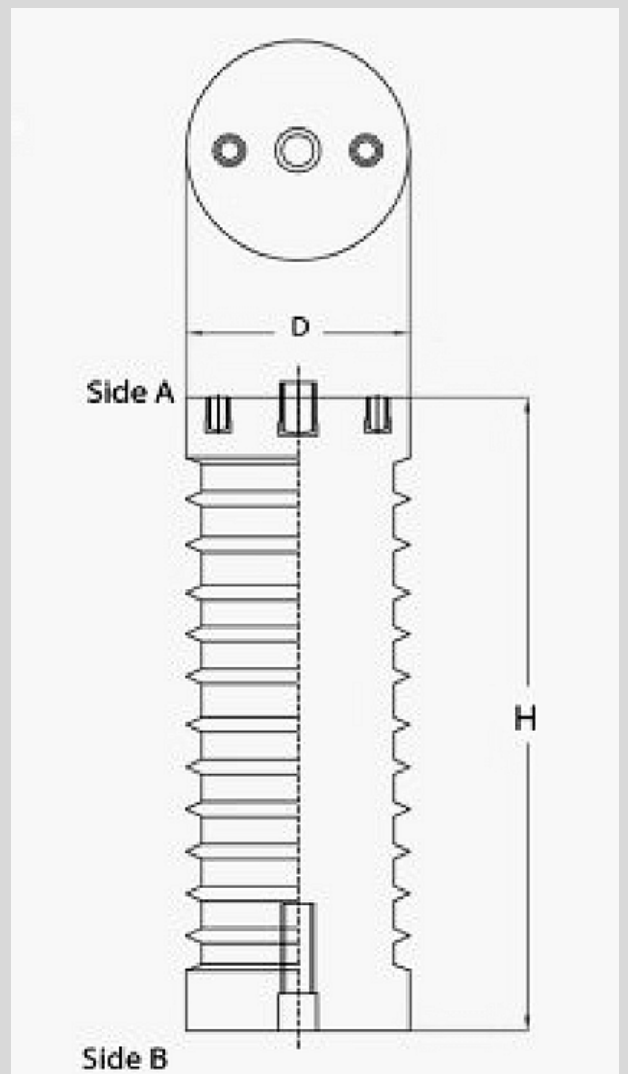

MV 33 KV - TYPE TESTS

مقره ۳۳ کیلوولت تابلویی محصول شرکت جبال الکتریک



Document Code: LQF-708-02-01
Document Review Date: 01.07.30

Page 3 of 11

H5-70084

1. GENERAL INFORMATION

1.1. Product Information

Equipment under Test : Indoor Post Insultaor
 Manufacturer : Jebal Electric
 Code : Mv33
 Type : J02-170
 Rated Voltage : 33 kV
 Height : 300 mm
 Diameter : 80 mm
 Normative Document : IEC 60660:1999

1.2. Client Information

Applicant : Jebal Electric
 Telefax : +98(34)32152501-3

1.3. Performed Tests

Test	Test According to	Result
Dry Power-Frequency Withstand Voltage Test	IEC 60660:1999	Passed
Dry Lightning Impulse Withstand Voltage Test	IEC 60660:1999	Passed
Mechanical failing load test – bending test	IEC 60660:1999	Passed

1.4. Test Results and Descriptions:

See pages 4 to 8.



This report should not be reproduced in ex tracts without written approval by EPIIL. Test result pertain to tested sample only. This report is not valid without Lab stamp.

Head-office: Unit 12, No. 2, Boujari Sefat Dead-End, Corner of Fariman St., Bozorgmehr St., Valli-Asr Ave., Tehran-Iran.
 Postal Code: 1416854523 Tel: (+9821) 61971 Fax (+9821) 66174283
 Lab: Kavosh Research City, Supa Blvd., 8th km of Karaj-Qazvin Freeway, Iran.
 Postal Code: 3365166551 Tel: (+9826) 34996700-14 Fax (+9826) 34996715

هرگونه تکثیر این گزارش به صورت جزئی یا کلی بدون تایید کتبی اپیل ممنوع می باشد. نتایج آزمون ها تنها در رابطه با نمونه آزمون شده معتبر است. این گزارش بدون مهر فاقد اعتبار است.
 دفتر مرکزی: تهران، خیابان ولیعصر، خیابان بزرگمهر، نبش فریمان، بن بست بوجاری سفات، پلاک ۲، طبقه ۳، واحد ۱۲.
 کد پستی: ۱۴۱۶۸۵۴۵۳۳ تلفن: ۶۱۹۷۱- (+۹۸۲۱) فکس: ۶۶۱۷۴۲۸۳- (+۹۸۲۱)
 آزمایشگاه: کیلومتر ۸ اتوبان کرچ - قزوین، بلوار سوپا، شهرک تحقیقاتی کاوش، شرکت آزمایشگاه های صنایع انرژی.
 کد پستی: ۳۳۶۵۱۶۶۵۵۱ تلفن: ۳۴۹۹۶۷۰-۱۴- (+۹۸۲۶) فکس: ۳۴۹۹۶۷۱۵- (+۹۸۲۶)